



**NOTES:**

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
2. A MINIMUM CLEARANCE OF 500mm TO BE MAINTAINED TO IRISH WATER MAINS, ELECTRIC CABLES, STORMWATER MAINS, SEWER GRAVITY MAINS, GAS DISTRIBUTION MAINS AND ALL OTHER SERVICES AS PER IS 328:2021 AND GNI/AD/SP/007.
3. MARKER TAPE TO BE DETECTABLE 300mm WIDE TAPE LABELLED "CAUTION BURIED GAS PIPE".

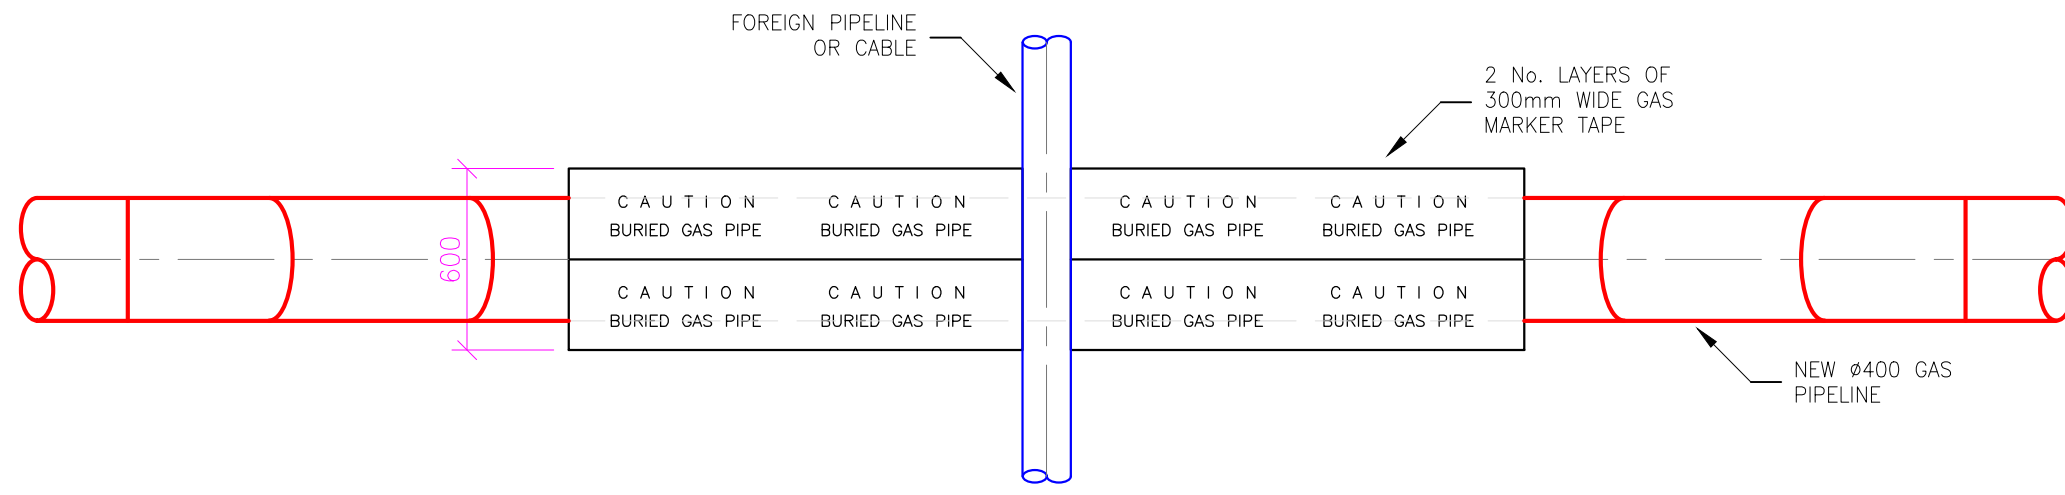

**PLAN VIEW**  
(Not to Scale)

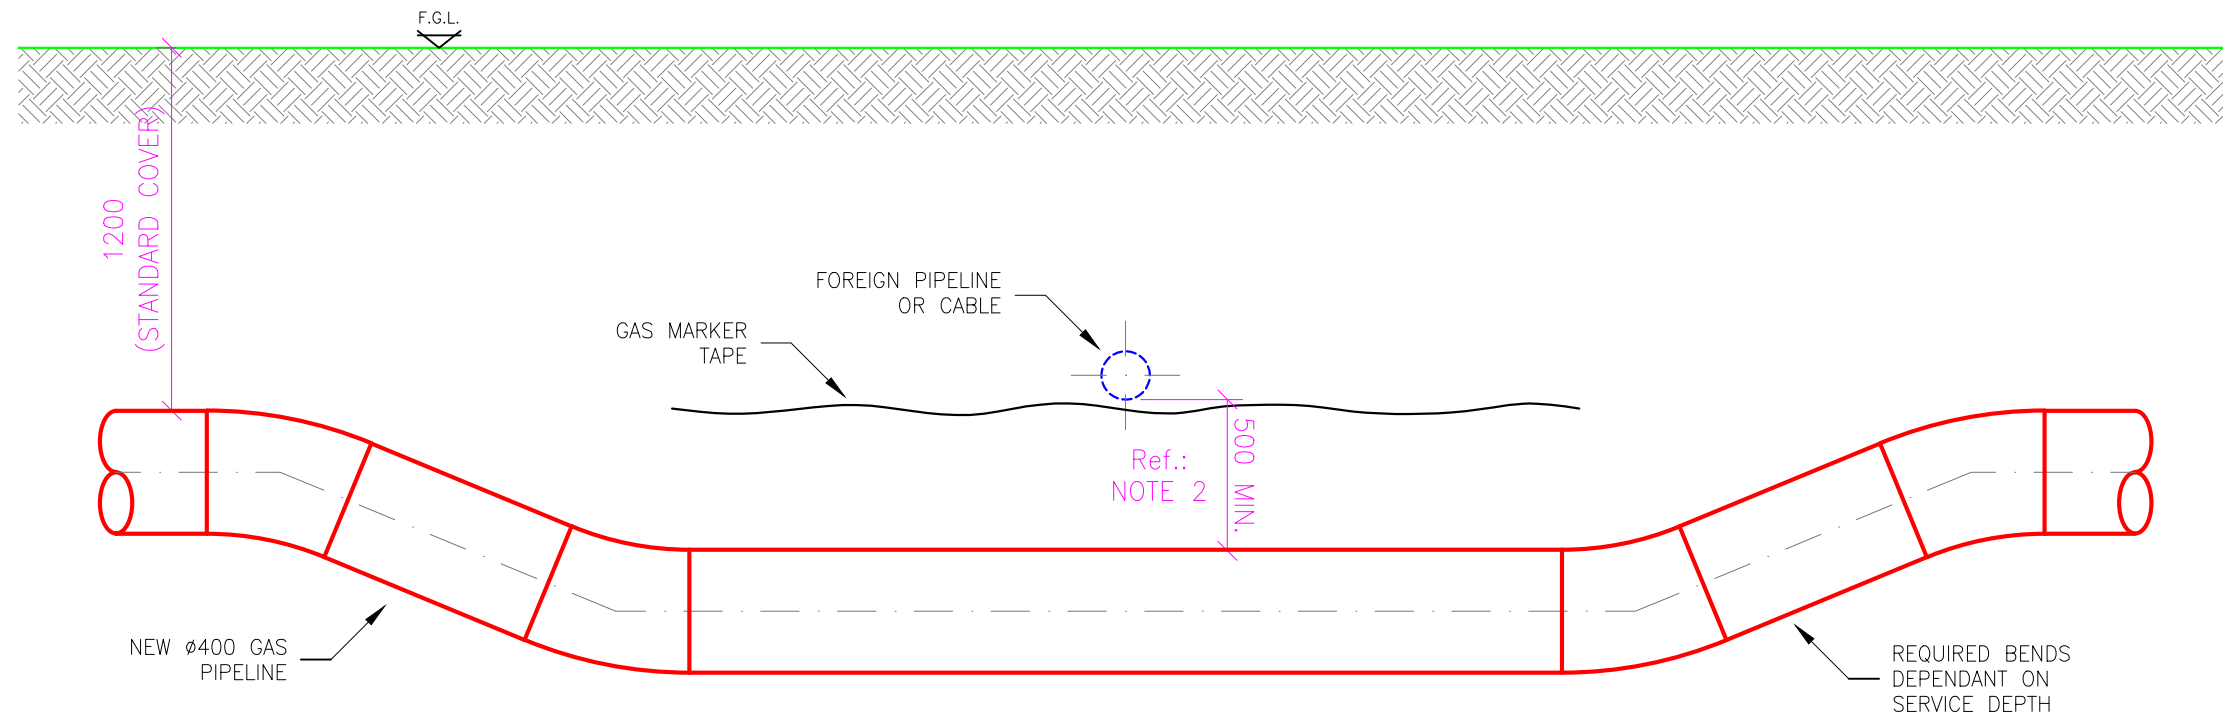

**SECTION**  
(Not to Scale)

**SECTION 39A APPLICATION**

0	SECTION 39A APPLICATION ISSUE	AT	MAH	MC							<b>APPROVALS</b>			PROJECT 45924538-GAS TO MILLTOWN (BULMER) GRANGE CASTLE		
		09/01/2026	09/01/2026	09/01/2026												
											B	DESIGN ENGINEERING	CHECKED T.MALONE	TITLE TYPICAL 3rd PARTY SERVICE CROSSING GAS TO MILLTOWN PIPELINE		
											C	STRATEGY/PLANNING	APPROVAL M.CULLEN			
ISSUE	REVISION	REV. BY	A	B	C	D	E	F	G		D	DESIGN MANAGEMENT	DATE 05/12/2025	DRAWING NUMBER 1587-DG-PLG-0006	SCALE AS SHOWN @A3	SHEET 01 OF 01
CONSULTANT <b>Fingleton White</b> Bridge Street Centre Portlaoise Co. Laois Ireland T:(00353)(0)57 866 5400 www.fingleton.ie					P.O Box 51, Gasworks Road, Cork, Rep of Ireland T +353 21 4534000											